


**PLAN VIEW
MOUNTING BASE DETAIL**

NOTES

1. BARE COPPER GROUNDING CONDUCTOR SHALL BE LOOPED AROUND ANCHOR BOLTS ONE TIME AND CONNECTED TO EACH ANCHOR BOLT BEFORE CONTINUING DOWN TO THE GROUNDING PLATE.
2. IN AREAS WHERE R/W PERMITS, THE CONCRETE BASE SHALL BE PLACED AT THE BACK EDGE OF THE SIDEWALK.
3. REFER TO STD. DWG. 331 FOR SERVICE PEDESTAL SETBACK AND ORIENTATION.
4. WIRE SIZES ARE BASED ON UNDERGROUND FEED.
5. WIRE SIZES SHALL BE INCREASED FOR VOLTAGE DROP LIMITATION WHEN RUN IS LONG.
6. PULLBOX LOCATION TO BE DETERMINED BY THE ENGINEER.
7. WHERE FOUNDATION IS INSTALLED IN SIDEWALK, A CLEAR WIDTH OF 48" MIN. SHALL BE MAINTAINED ON SIDEWALK.

		AGENCY APPROVED	B	C	H	L	M	N	R
SPECIFICATION REFERENCE		UNIFORM STANDARD DRAWINGS CLARK COUNTY AREA							
501	PORTLAND CEMENT CONCRETE	SERVICE PEDESTAL FOUNDATION STREET LIGHTING AND/OR TRAFFIC SIGNAL							
623	TRAFFIC SIGNALS & STREET LIGHTING								
		DATE 03-12-20	DWG. NO. 332				SHEET 1 OF 2		

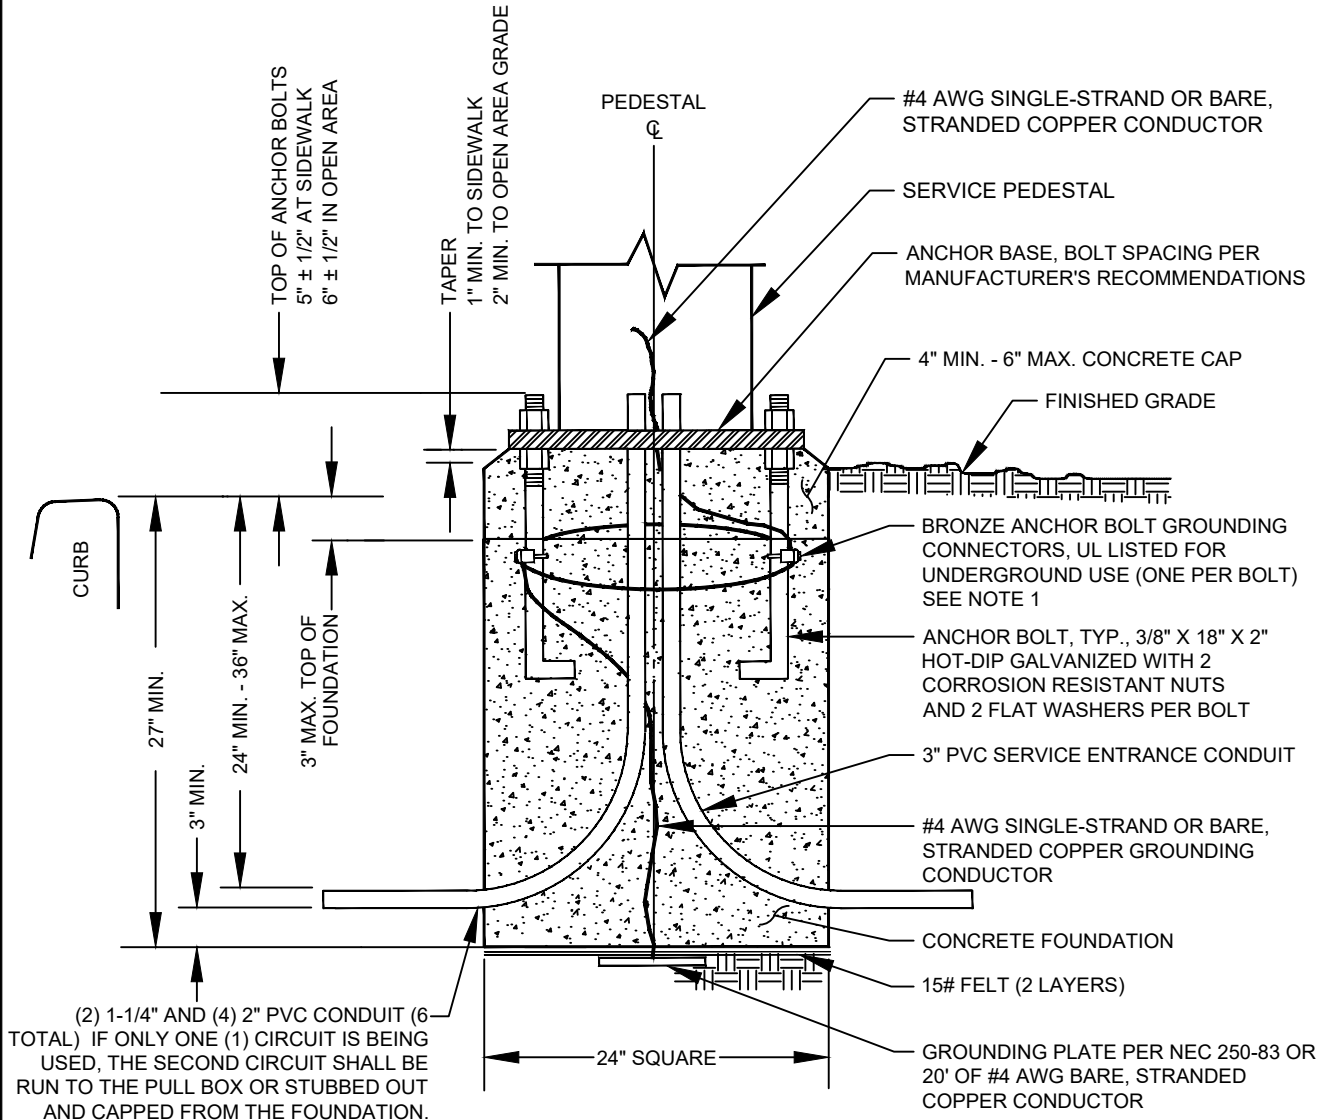

SECTION

PROFESSIONAL ELECTRICAL ENGINEER STAMP ON FILE		AGENCY APPROVED	B	C	H	L	M	N	R
SPECIFICATION REFERENCE		UNIFORM STANDARD DRAWINGS CLARK COUNTY AREA							
501	PORTLAND CEMENT CONCRETE	SERVICE PEDESTAL FOUNDATION STREET LIGHTING AND/OR TRAFFIC SIGNAL							
623	TRAFFIC SIGNALS & STREET LIGHTING								
		DATE 03-12-20	DWG. NO. 332			SHEET 2 OF 2			