


PLAN

DETAIL "I"

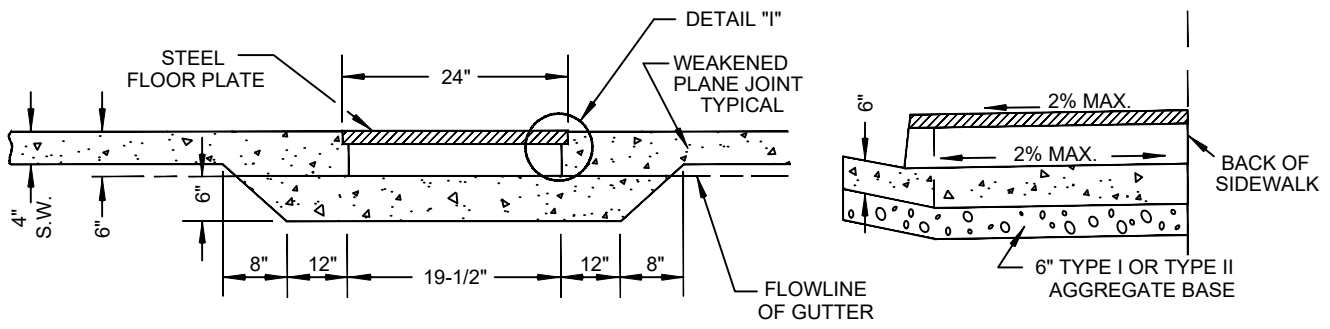

SECTION A-A

SECTION B-B

NOTES

1. IF WIDTH OF PLATE IS GREATER THAN 24", A SPECIAL DESIGN IS REQUIRED.
2. ALL EXPOSED METAL PARTS SHALL BE GALVANIZED, AND ALL GALVANIZING DAMAGED BY FABRICATION OR INSTALLATION SHALL RECEIVE TWO COATS OF ALUMINUM PAINT (GALVONOX OR EQUAL). EXPOSED METAL PARTS IN THE PEDESTRIAN ACCESS ROUTE SHALL BE FIRM, STABLE, AND SLIP-RESISTANT.
3. TACK WELDS BETWEEN SIDEWALK AND STEEL PLATE FLOOR WITHIN PEDESTRIAN ACCESS ROUTES SHALL HAVE NO VERTICAL SURFACE DISCONTINUITIES GREATER THAN 1/4", REGARDLESS OF CONSTRUCTION TOLERANCES.

AGENCY APPROVED		B	C	H	L	M	N	R
SPECIFICATION REFERENCE		UNIFORM STANDARD DRAWINGS CLARK COUNTY AREA						
302	BASE AGGREGATES	SIDEWALK DRAIN						
501	CONCRETE							
710	STRUCTURAL STEEL							
DATE 03-12-20		DWG. NO. 236						