


PLAN


NOTES

1. SEE GENERAL NOTES STANDARD DRAWING NO. 313.
2. CONTINUOUS BARE COPPER GROUNDING CONDUCTOR SHALL BE LOOPED AROUND ANCHOR BOLTS ONE TIME AND CONNECTED TO EACH ANCHOR BOLT BEFORE CONTINUING DOWN TO THE POLE GROUNDING PLATE.
3. FOUNDATION CAP SHALL BE CONCRETE OR GROUT AS DESIGNATED BY THE ENTITY ENGINEER.

		AGENCY APPROVED	B	C	H	L	M	N	R
SPECIFICATION REFERENCE		UNIFORM STANDARD DRAWINGS CLARK COUNTY AREA							
501	PORTLAND CEMENT CONCRETE	LIGHTING STANDARD FOUNDATION							
623	TRAFFIC SIGNALS & STREETLIGHTING								
		DATE 01-09-20	DWG. NO. 321			SHEET 1 OF 2			

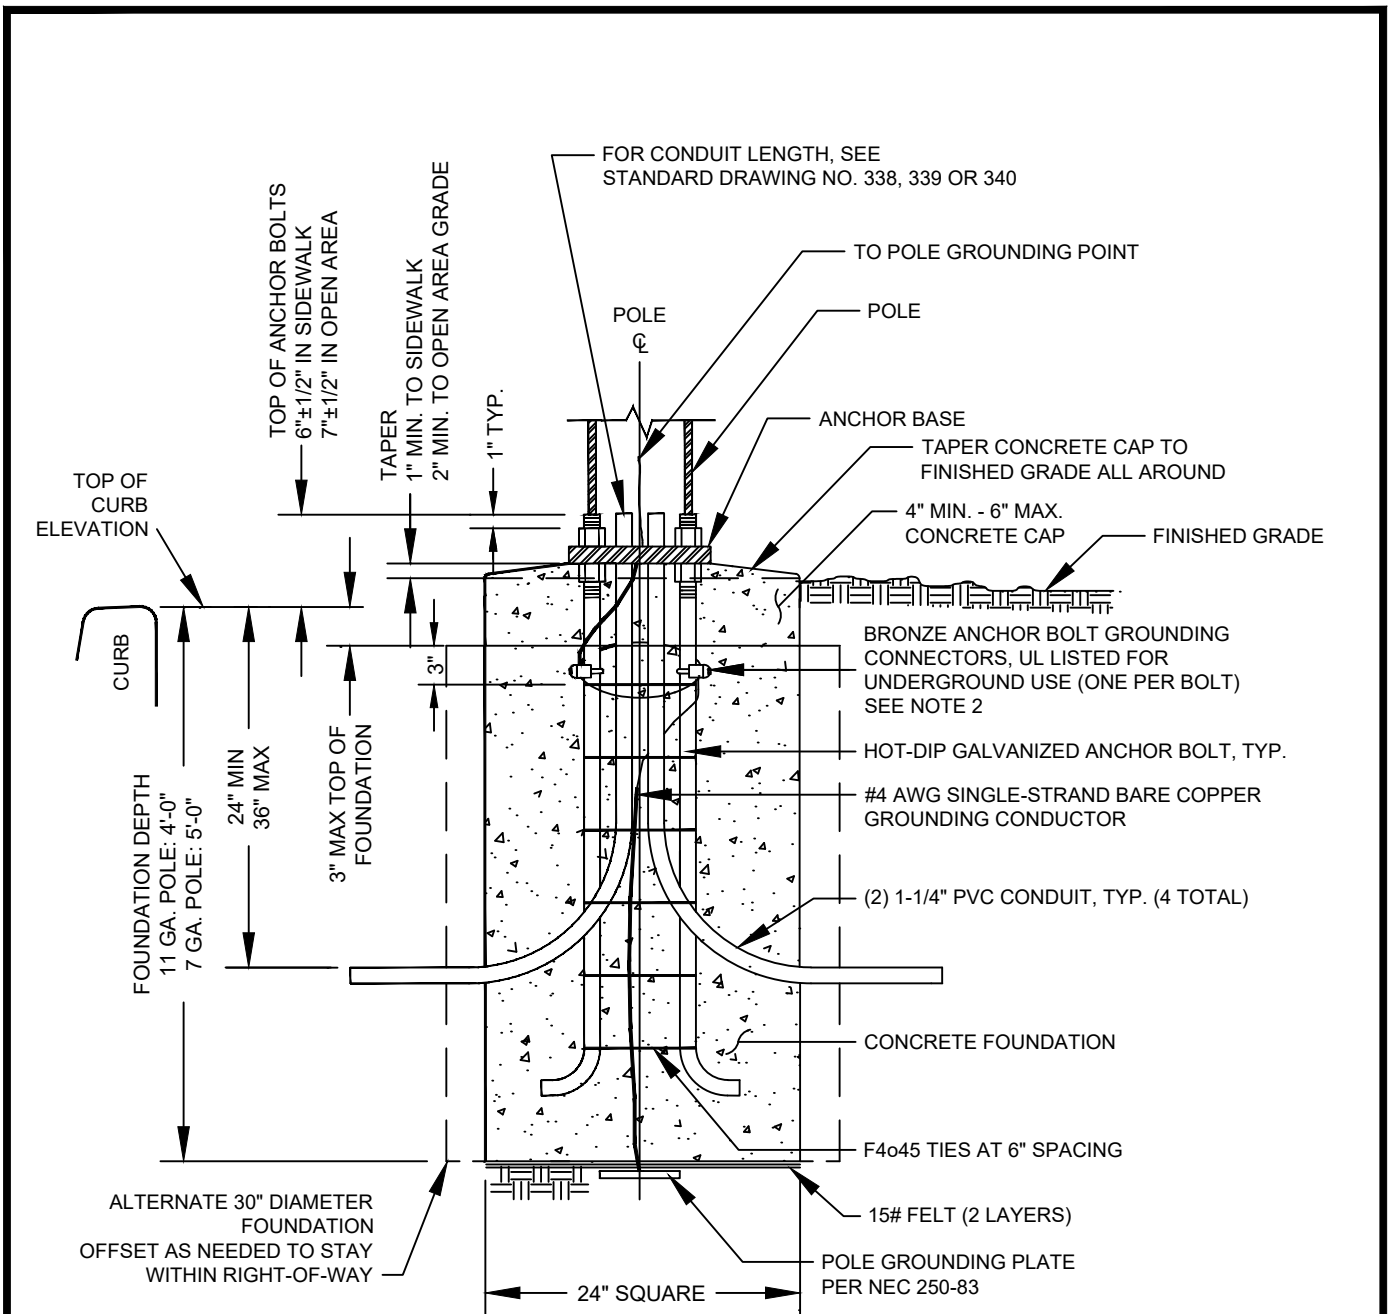

SECTION



PROFESSIONAL ELECTRICAL ENGINEER STAMP ON FILE		AGENCY APPROVED	B	C	H	L	M	N	R
SPECIFICATION REFERENCE		UNIFORM STANDARD DRAWINGS CLARK COUNTY AREA							
501	PORTLAND CEMENT CONCRETE	LIGHTING STANDARD FOUNDATION							
623	TRAFFIC SIGNALS & STREETLIGHTING								
		DATE 01-09-20	DWG. NO. 321			SHEET 2 OF 2			